

RIVERBEND WIND ENERGY FACILITY



Exhibit A-1.10 FIRE RESPONSE PLAN

Table of Contents

EXHIBIT A-1.10 – FIRE RESPONSE PLAN.....	2
--	---

Appendices

Appendix 1.10-A: FIRE RESPONSE PLAN

Appendix 1.10-B: CORRESPONDENCE SUMMARY TABLE & DOCUMENTATION

EXHIBIT A-1.10 – FIRE RESPONSE PLAN (FRP)

A-1.10.a – The FRP shall include the following:

- 1. Evidence of consultation or a good-faith effort to consult with local fire department representatives to ensure that the FRP is in alignment with acceptable operating procedures, capabilities, resources, etc. If consultation with local fire department representatives is not possible, provide evidence of consultation or a good-faith effort to consult with the State Fire Marshal or other local emergency manager.**
- 2. A description of all on-site equipment and systems to be provided to prevent or handle fire emergencies.**
- 3. A description of all contingency plans to be implemented in response to the occurrence of a fire emergency.**
- 4. For energy storage projects, a commitment to offer to conduct, or provide funding to conduct, site-specific training drills with emergency responders before commencing operation, and at least once per year while the facility is in operation. Training should familiarize local fire departments with the project, hazards, procedures, and current best practices.**
- 5. For wind and solar projects, a commitment to conduct, or provide funding to conduct, site-specific training drills with emergency responders before commencing operation, and upon request while the facility is in operation. Training should familiarize local fire departments with the project, hazards, procedures, and current best practices.**
- 6. A commitment to review and update the FRP with fire departments, first responders, and county emergency managers at least once every 3 years.**
- 7. An analysis of whether plans to be implemented in response to a fire emergency can be fulfilled by existing local emergency response capacity. The analysis should include identification of any specific equipment or training deficiencies in local emergency response capacity and recommendations for measures to mitigate deficiencies.**
- 8. Other information the applicants find relevant.**

Refer to the draft Fire Response Plan (FRP) provided in **Appendix 1.10-A – Fire Response Plan**. Documentation of the Applicant's efforts to consult with local first responders is included in **Appendix 1.10-B – Correspondence Summary Table & Documentation**.

A-1.10.b – Changes to the design, type, manufacturer, etc. of facilities or equipment after the initial filing must be analyzed to determine if changes are necessary to the FRP. Additional consultation with local fire departments, first responders, and county emergency managers is required for amended plans.

If the Project's design, type, or manufacturer of facilities and equipment changes after the initial filing, the Applicant is committed to analyzing the FRP for any necessary updates and consulting with local fire departments, first responders, and county emergency managers regarding any required amendments to emergency response protocols. Refer to the draft Fire Response Plan provided in **Appendix 1.10-A – Fire Response Plan**.

Appendix 1.10-A: FIRE RESPONSE PLAN



EXHIBIT A-1.10

DRAFT FIRE RESPONSE PLAN

RIVERBEND WIND ENERGY FACILITY

Submitted by Atwell, LLC

On behalf of

MI Energy Developments, LLC
575 5th Ave, Suite 2501
New York, NY 10017

February 27, 2025

TABLE OF CONTENTS

1	INTRODUCTION.....	3
1.1	PROJECT DESCRIPTION.....	3
1.2	LOCAL CONSULTATION	4
1.3	ON-SITE FIRE PREVENTION EQUIPMENT & SYSTEMS.....	4
1.4	CONTINGENCY PLANS	5
1.5	EMERGENCY RESPONSE ROUTES.....	6
1.6	FIRE RESPONSE TRAINING.....	6
1.7	LOCAL EMERGENCY RESPONSE CAPACITY.....	7

APPENDICES

Appendix A – Emergency Response Routes

ACRONYMS AND ABBREVIATIONS

Atwell	Atwell, LLC
FRP	Fire Response Plan
MPSC	Michigan Public Service Commission
O&M	Operations & Maintenance
PPE	Personal Protection Equipment

1 INTRODUCTION

This Fire Response Plan (FRP) is intended to fulfill the Exhibit A-1.10 requirement of Riverbend Wind Energy Facility's (Project) application for Michigan Public Service Commission (MPSC) approval of a Renewable Energy Certificate. It summarizes all means and procedures for a rapid response in case of a fire emergency. A separate Emergency Response Plan which outlines response measures for other emergencies is found in **Appendix 1.9-A** within **Exhibit A-1.9** of this application.

This plan has been developed to prevent, mitigate, and effectively respond to a fire emergency, should one occur. It includes a Project overview, security measures for the Project, emergency and routine shutdown procedures, identifies potential contingencies that would constitute a safety or security emergency, and outlines what the emergency response, evacuation control, and community notification procedures are in the event of an emergency.

Please note that the emergency protocols described herein only pertain to the regular operation of the project and do not include construction activities. The Engineering, Procurement, and Construction Team will provide separate safety measures and protocols before and during construction of the Project.

MI Energy Developments, LLC (Applicant) will review and update this FRP with local fire departments, first responders, and county emergency managers before the start of commercial operation of the Project and at least once every 3 years. The Applicant's goal is to ensure the FRP remains comprehensive, up-to-date, and fully aligned with local and industry standards, thereby enhancing overall preparedness and response capabilities for all types of emergency incidents.

In the event of a fire emergency, dial 911

1.1 PROJECT DESCRIPTION

The Project is located in Fremont, Speaker, and Elk townships, Sanilac County, Michigan. The Project consists of 50 turbine pad locations: 26 within Fremont Township and 24 within Speaker Township. There are no turbines proposed within Elk Township. In addition to the 50 proposed wind turbines, Project plans also include the following: underground electrical collection system, substation, overhead transmission line connection, laydown yard, Operations & Maintenance (O&M) facility, switching station, three MET towers, and turbine access roads.

The Project Layout is depicted in **Appendix 1.1-A** within **Exhibit A-1.1** of this application.

1.2 LOCAL CONSULTATION

The Applicant is in the process of consultation to collaborate with local first responders and county emergency managers to ensure this FRP aligns with existing operating procedures, capabilities, and resources. Feedback received from those conversations, will be incorporated into this FRP to ensure that it aligns with the capabilities of local emergency managers and first responders.

Additionally, the Applicant provided access to site layouts, maps, and designated ingress and egress points to facilitate site access during emergencies. The Applicant remains committed to ongoing collaboration with these stakeholders to ensure that the FRP remains comprehensive, effective, and fully aligned with local emergency response requirements.

1.3 ON-SITE FIRE PREVENTION EQUIPMENT & SYSTEMS

Riverbend Wind is committed to keeping the community and on-site operations personnel safe during operation of the Project. Riverbend Wind will present basic fire-prevention training to all personnel working at the Project. Additionally, the following equipment and systems will be retained on-site to prevent or handle fire emergencies:

- All employees, contractors, and contractor personnel are expected to take all reasonable actions within their authority, expertise, and consideration of human safety to prevent and suppress fires arising from project construction or maintenance activities on lands occupied under this permit. Riverbend Wind is responsible for ensuring that all employees, subcontractors, and any other individuals or entities working on the project site are informed of the requirements of this Fire Prevention and Suppression Plan, are familiar with the location and proper use of firefighting equipment, and conduct their activities in a fire-safe manner.
- Exhaust systems of vehicles will have an acceptable muffler and will be in proper working condition. All motorized equipment and machinery will be equipped with spark arresters.
- Vehicles will only be parked in cleared areas.
- No smoking will be permitted on site.
- Fuels and flammable materials, if required, will be stored in accordance with all applicable state and federal laws and industry best practices.
- The Project site will be equipped with fire extinguishers and other equipment sufficient to extinguish small fires.

- Riverbend Wind will isolate or shutdown the electrical power at the site of the fire, if possible.
- Electrical components produce gas during combustion. All responders should use a self-contained breathing apparatus.
- All inverters contain energy storage devices that require 15 minutes to safely deenergize to non-lethal voltages. It is important to remember not to touch inverters until they are safely deenergized.
- First responders as well as Project personnel on-site shall not touch electrical components without wearing required Personal Protection Equipment (PPE).

The Project site plan, found in Exhibit A-1.1 of this application, displays potential approach and departure routes to and from each facility component for police, fire, ambulance, and other emergency vehicles.

1.4 CONTINGENCY PLANS

Though the potential for fires at the Project site is limited, in the event of a fire emergency on site, Riverbend Wind has developed a series of protocols for on-site personnel.

In the event of a fire, the individual discovering the emergency shall:

1. Notify the appropriate authorities by dialing 911 and direct them to the Project access point identified on the site plan.
2. Assess the situation to determine potential safety concerns to life and the environment, with life safety as the priority.
3. Local authorities should contact the Riverbend Wind site manager to determine the appropriate response procedures and methods for safe access and, if necessary, proper shut down measures of any project components.

Upon arrival to the Project, first responders shall:

1. Contact the Riverbend Wind site manager as directed.
2. Evacuate and secure the area. This may include evacuation of nearby buildings if deemed necessary by fire response personnel.
3. Contain the fire within the facilities to ensure that resources are allocated to protecting life and property outside of the Project site.

1.5 EMERGENCY RESPONSE ROUTES

The Project has provided a detailed identification of potential approach and departure routes for police, fire, ambulance, and other emergency response vehicles. This information includes clearly marked ingress and egress points, as well as designated travel paths within the facility. Refer to **Appendix A – Emergency Response Routes**. Additionally, the following roadways and entrances will serve as primary access points for emergency response vehicles:

PRIMARY ACCESS ROADS

- **Peck Road (M-90):** This road provides direct access to the facility's northern entrance and connects to Brockway Road (M-19).
- **Brockway Road (M-19):** This road leads to the southern perimeter entrance and connects with Fisher Road.
- **Burns Line Road:** This road serves as the western access point and is suitable for larger emergency vehicles due to its wide turning radius. This road also reads directly to the projects O&M facility.

ENTRANCE LOCATIONS

- **O&M Entrance:** Located at the intersections of Brown Road and Burns Line Road, this entrance is accessible and will include clear signage for emergency vehicles. This entrance also provides access to the Project substation and switch yard, which will remain locked for security.
- **Turbine Entrances:** Each turbine location will be serviced by an access road wide enough for emergency vehicles navigate.

Maps detailing these access routes and entrance locations will be provided to local emergency response teams during pre-construction coordination meetings and annual site safety reviews. This information will also be displayed at Project control points and shared with emergency personnel to ensure a coordinated and effective response to a fire emergency.

1.6 FIRE RESPONSE TRAINING

Riverbend Wind will notify relevant emergency response agencies and fire departments having jurisdiction of the Project area prior to construction. Fire response personnel will be invited to visit the Project site to obtain an on-the-ground understanding of the Project layout, access points, and protocols in place. Riverbend Wind commits to conducting or providing funding to conduct site-specific training drills with emergency responders prior to construction and during

operation on request. Training provided to first responders will familiarize the local fire department with the project, hazards, procedures, and current best practices.

1.7 LOCAL EMERGENCY RESPONSE CAPACITY

The typical operations of the Riverbend Wind Energy Facility will not create nuisance or safety hazards due to dust, noise, smell, vibration, smoke, or lighting. The Project includes engineering and safety controls for smoke and fire detection, stray voltage prevention, and explosion control. Inspections and preventative maintenance are performed consistent with industry practice and manufacturer recommendations based upon turbine hours, age, and performance history. Consequently, the Project is not expected to require additional local emergency resources.

Prior to the commencement of construction, the Applicant will coordinate with local emergency service providers, including the Speaker Township Fire Department and Elk Township Fire/Rescue, to conduct a site orientation that familiarizes personnel with site access routes, safety infrastructure, and emergency protocols. In addition, the Applicant will perform an assessment of local emergency response capacity to identify any deficiencies in equipment or training specific to the needs of the Project. Based on this assessment, the Applicant will provide recommendations for measures to ensure emergency responders are fully prepared to support fire and emergency scenarios at the site. If, at any time during construction or operation, the Speaker Township Fire Department or Elk Township Fire/Rescue indicates that they do not possess the necessary training or equipment to effectively respond to a fire or related emergency, Riverbend Wind will reasonably fund the acquisition of needed equipment and/or the provision of additional training to address the identified deficiencies.

APPENDIX A


EMERGENCY RESPONSE ROUTES



FREMONT & SPEAKER TOWNSHIPS
SANILAC COUNTY, MICHIGAN

RIVERBEND WIND ENERGY
FACILITY
EMERGENCY ACCESS ROUTES

DRAWN BY: BS
DATE: 02-26-2025
0 1/2 MILE 1 MILE
SCALE: 1"=1 MILE

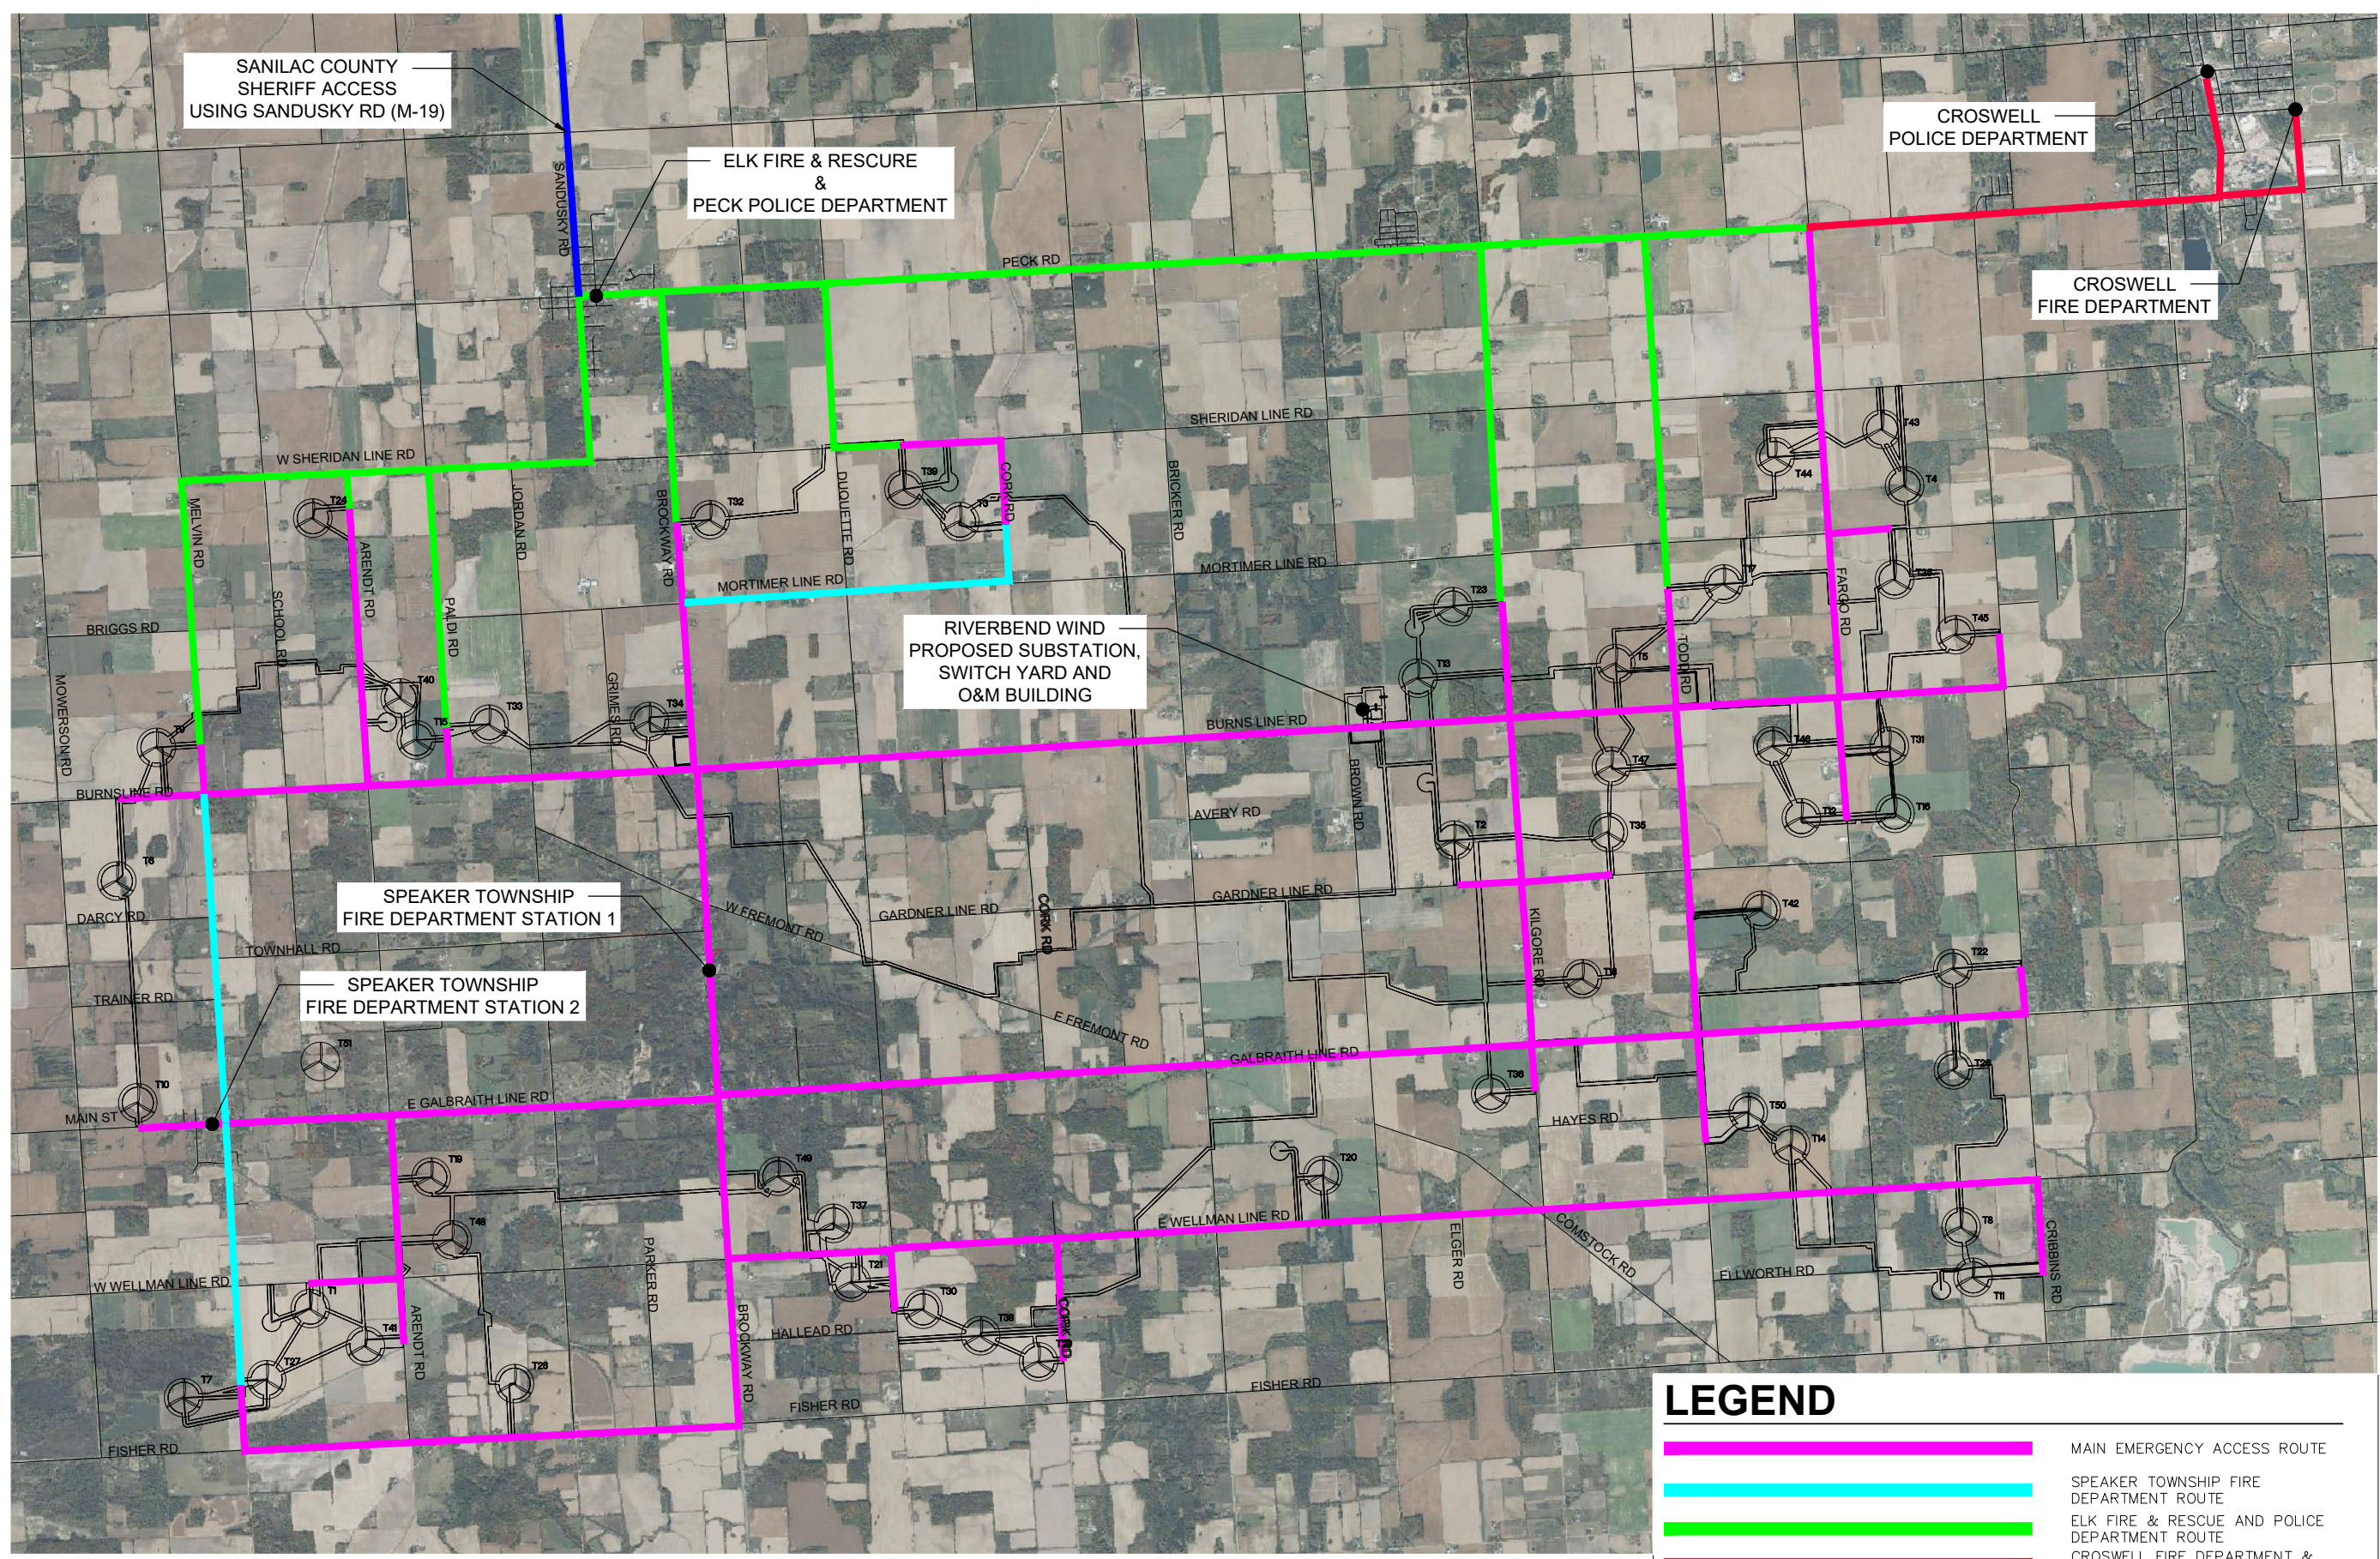

SANILAC COUNTY
SHERIFF ACCESS
USING SANDUSKY RD (M-19)

ELK FIRE & RESCUE
&
PECK POLICE DEPARTMENT

CROSWELL
POLICE DEPARTMENT

CROSWELL
FIRE DEPARTMENT

RIVERBEND WIND
PROPOSED SUBSTATION,
SWITCH YARD AND
O&M BUILDING

SPEAKER TOWNSHIP
FIRE DEPARTMENT STATION 1

SPEAKER TOWNSHIP
FIRE DEPARTMENT STATION 2

LEGEND

- MAIN EMERGENCY ACCESS ROUTE
- SPEAKER TOWNSHIP FIRE DEPARTMENT ROUTE
- ELK FIRE & RESCUE AND POLICE DEPARTMENT ROUTE
- CROSWELL FIRE DEPARTMENT & POLICE DEPARTMENT ROUTE
- SANILAC COUNTY SHERIFF ROUTE

Appendix 1.10-B: CORRESPONDENCE SUMMARY TABLE & DOCUMENTATION

Riverbend Wind First Responders Communication						
Organization	Contact	Address	Phone Number	Email	Communication Log	Notes
Croswell Fire Department	Fire Chief: Steve Bales	7 North Croswell Road Croswell, MI 48422	810-679-2346	croswellfire@gmail.com	12/9/2025 - email sent	Call received 12/15, did not think an additional meeting would be necessary.
Croswell Police Department	Police Chief: Jason Schoen	100 North Howard Avenue Croswell, MI 48422	810-679-2200	PoliceChief@croswell.us	12/9/2025 - email sent	No response to date.
Elk Township Fire/Rescue	Fire Chief: Ernest Kilgus	29 East Lapeer Road Peck, MI 48466	810-648-2000 or 810-378-5472	elkfirerescue@gmail.com	12/9/2025 - email sent	No response to date.
Peck Police Department	Police Chief: Rob Major	30 East Lapeer Road Peck, MI 48466	810-378-5131	rmajorvillageofpeck@gmail.com	12/9/2025 - email sent	Email received 12/11/2025, stated project is outside of jurisdiction. Asked if we had reached out to Sanilac County Sheriff. Pointed out discrepancy in mapping. Response sent 12/17/2025
Sanilac County Sheriff	Sheriff Paul D. Rich Undersheriff: Nathan Smith	65 N Elk Street Sandusky, MI 48471	810-648-2000 Nathan Smith: 810-648-8355	nsmith@sanilaccounty.net	12/9/2025 - called and left a VM 12/10/2025 - received VM 12/15/2025 - email sent	No response to date.
Speaker Township Fire Department Station 1	Fire Chief: Donald L. Priess III	7628 Brockway Road Melvin, MI 48454	810-650-7871	firechief@speakertwpmi.gov	12/9/2025 - email sent	No response to date.



February 27, 2025

Croswell Fire Department
7 North Croswell Road
Croswell, Michigan, 48422

RE: Riverbend Wind – Emergency Response & Fire Response Plans
Atwell Project Number: 24006759

To whom it may concern,

Atwell is reaching out on behalf of REV Renewables, the developer of the proposed Riverbend Wind Energy Center project, in regard to the Emergency Response and Fire Response Plans, under separate cover. The project team would like to coordinate with the Croswell Fire Department to discuss the proposed plans and address any questions, concerns or proposed edits you may have. If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Respectfully,

ATWELL, LLC

Southfield, MI



Ben Sanford
Project Manager



February 27, 2025

Croswell Police Department
100 North Howard Avenue
Croswell, Michigan, 48422

RE: Riverbend Wind – Emergency Response & Fire Response Plans
Atwell Project Number: 24006759

To whom it may concern,

Atwell is reaching out on behalf of REV Renewables, the developer of the proposed Riverbend Wind Energy Center project, in regard to the Emergency Response and Fire Response Plans, under separate cover. The project team would like to coordinate with the Croswell Police Department to discuss the proposed plans and address any questions, concerns or proposed edits you may have. If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Respectfully,

ATWELL, LLC

Southfield, MI

Ben Sanford
Project Manager



February 27, 2025

Elk Township Fire/Rescue
29 East Lapeer Road
Peck, Michigan, 48466

RE: Riverbend Wind – Emergency Response & Fire Response Plans
Atwell Project Number: 24006759

To whom it may concern,

Atwell is reaching out on behalf of REV Renewables, the developer of the proposed Riverbend Wind Energy Center project, in regard to the Emergency Response and Fire Response Plans, under separate cover. The project team would like to coordinate with Elk Township Fire/Rescue to discuss the proposed plans and address any questions, concerns or proposed edits you may have. If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Respectfully,

ATWELL, LLC

Southfield, MI

Ben Sanford
Project Manager



February 27, 2025

Peck Police Department
30 East Lapeer Road
Peck, Michigan, 48466

RE: Riverbend Wind – Emergency Response & Fire Response Plans
Atwell Project Number: 24006759

To whom it may concern,

Atwell is reaching out on behalf of REV Renewables, the developer of the proposed Riverbend Wind Energy Center project, in regard to the Emergency Response and Fire Response Plans, under separate cover. The project team would like to coordinate with the Peck Police Department to discuss the proposed plans and address any questions, concerns or proposed edits you may have. If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Respectfully,

ATWELL, LLC

Southfield, MI



Ben Sanford
Project Manager



February 27, 2025

Sanilac County Sheriff
65 N Elk Street
Sandusky, Michigan 48471

RE: Riverbend Wind – Emergency Response & Fire Response Plans
Atwell Project Number: 24006759

To whom it may concern,

Atwell is reaching out on behalf of REV Renewables, the developer of the proposed Riverbend Wind Energy Center project, in regard to the Emergency Response and Fire Response Plans, under separate cover. The project team would like to coordinate with the Sanilac County Sheriff to discuss the proposed plans and address any questions, concerns or proposed edits you may have. If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Respectfully,

ATWELL, LLC

Southfield, MI

Ben Sanford
Project Manager



February 27, 2025

Speaker Township Fire Department Station 1
7628 Brockway Road
Melvin, Michigan, 48454

RE: Riverbend Wind – Emergency Response & Fire Response Plans
Atwell Project Number: 24006759

To whom it may concern,

Atwell is reaching out on behalf of REV Renewables, the developer of the proposed Riverbend Wind Energy Center project, in regard to the Emergency Response and Fire Response Plans, under separate cover. The project team would like to coordinate with the Speaker Township Fire Department to discuss the proposed plans and address any questions, concerns or proposed edits you may have. If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Respectfully,

ATWELL, LLC

Southfield, MI

Ben Sanford
Project Manager



Proposed Riverbend Wind Project Follow-Up

From Edie Carney <ecarney@atwell.com>
Date Mon 12/15/2025 10:58 AM
To nsmith@sanilaccounty.net <nsmith@sanilaccounty.net>
Cc Benjamin Sanford <bsanford@atwell.com>

 4 attachments (4 MB)

Riverbend Wind Emergency Response Plan.pdf; Riverbend Wind Fire Response Plan.pdf; Riverbend Wind_Emergency Access Map.pdf; Sanilac County Sheriff.pdf;

Hello Sheriff Nathan Smith,

This email is to follow up on the Emergency Response Plan and Fire Response Plan prepared for the Riverbend Wind Energy Facility (the Project) proposed by MI Energy Developments, LLC (the applicant), a subsidiary of REV Renewables. The Fire Response Plan and Emergency Response Plan were sent to your department via U.S. certified mail on February 27, 2025 in accordance with the new Michigan Public Service Commission (MPSC) guidelines. The plans, as well as a copy of the initial letter are attached for reference. To date, a response has not been received, and the applicant would like to again extend an invitation to meet and discuss the proposed plans and address any questions, concerns or proposed edits you may have.

If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Regards,

Edie Carney (she/her)
Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

Two Towne Square | Suite 700 | Southfield, MI 48076

www.atwell.com

Local Solutions | National Presence





Proposed Riverbend Wind Project Follow-Up

From Edie Carney <ecarney@atwell.com>
Date Tue 12/9/2025 1:02 PM
To firechief@spekertwpmi.gov <firechief@spekertwpmi.gov>
Cc Benjamin Sanford <bsanford@atwell.com>

 4 attachments (4 MB)

Riverbend Wind Emergency Response Plan.pdf; Riverbend Wind Fire Response Plan.pdf; Riverbend Wind_Emergency Access Map.pdf; Speaker Township Fire Department Station 1.pdf;

Hello Fire Chief Donald L. Priess III,

This email is to follow up on the Emergency Response Plan and Fire Response Plan prepared for the Riverbend Wind Energy Facility (the Project) proposed by MI Energy Developments, LLC (the applicant), a subsidiary of REV Renewables. The Fire Response Plan and Emergency Response Plan were sent to your department via U.S. certified mail on February 27, 2025 in accordance with the new Michigan Public Service Commission (MPSC) guidelines. The plans, as well as a copy of the initial letter are attached for reference. To date, a response has not been received, and the applicant would like to again extend an invitation to meet and discuss the proposed plans and address any questions, concerns or proposed edits you may have.

If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Regards,

Edie Carney (she/her)
Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

Two Towne Square | Suite 700 | Southfield, MI 48076

www.atwell.com

Local Solutions | National Presence





Re: Proposed Riverbend Wind Project Follow-Up

From Edie Carney <ecarney@atwell.com>
Date Tue 12/9/2025 1:04 PM
To croswellfire@gmail.com <croswellfire@gmail.com>
Cc Benjamin Sanford <bsanford@atwell.com>

 1 attachment (436 KB)
Croswell Fire Department.pdf;

See attached initial letter.

Thanks,
Edie Carney (she/her)
Environmental Consultant
ATWELL, LLC
248.447.2000 Office
810.772.0349 Mobile

From: Edie Carney <ecarney@atwell.com>
Sent: Tuesday, December 9, 2025 12:47 PM
To: croswellfire@gmail.com <croswellfire@gmail.com>
Cc: Benjamin Sanford <bsanford@atwell.com>
Subject: Proposed Riverbend Wind Project Follow-Up

Hello Fire Chief Steve Bales,

This email is to follow up on the Emergency Response Plan and Fire Response Plan prepared for the Riverbend Wind Energy Facility (the Project) proposed by MI Energy Developments, LLC (the applicant), a subsidiary of REV Renewables. The Fire Response Plan and Emergency Response Plan were sent to your department via U.S. certified mail on February 27, 2025 in accordance with the new Michigan Public Service Commission (MPSC) guidelines. The plans, as well as a copy of the initial letter are attached for reference. To date, a response has not been received, and the applicant would like to again extend an invitation to meet and discuss the proposed plans and address any questions, concerns or proposed edits you may have.

If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Regards,
Edie Carney (she/her)
Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

Two Towne Square | Suite 700 | Southfield, MI 48076

www.atwell.com

Local Solutions | National Presence





Outlook

Re: Proposed Riverbend Wind Project Follow-Up

From Edie Carney <ecarney@atwell.com>
Date Tue 12/9/2025 1:04 PM
To PoliceChief@croswell.us <PoliceChief@croswell.us>
Cc Benjamin Sanford <bsanford@atwell.com>

 1 attachment (437 KB)
Croswell Police Department.pdf;

See attached initial letter.

Thanks,
Edie Carney (she/her)
Environmental Consultant
ATWELL, LLC
248.447.2000 Office
810.772.0349 Mobile

From: Edie Carney <ecarney@atwell.com>
Sent: Tuesday, December 9, 2025 12:50 PM
To: PoliceChief@croswell.us <PoliceChief@croswell.us>
Cc: Benjamin Sanford <bsanford@atwell.com>
Subject: Proposed Riverbend Wind Project Follow-Up

Hello Police Chief Jason Schoen,

This email is to follow up on the Emergency Response Plan and Fire Response Plan prepared for the Riverbend Wind Energy Facility (the Project) proposed by MI Energy Developments, LLC (the applicant), a subsidiary of REV Renewables. The Fire Response Plan and Emergency Response Plan were sent to your department via U.S. certified mail on February 27, 2025 in accordance with the new Michigan Public Service Commission (MPSC) guidelines. The plans, as well as a copy of the initial letter are attached for reference. To date, a response has not been received, and the applicant would like to again extend an invitation to meet and discuss the proposed plans and address any questions, concerns or proposed edits you may have.

If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Regards,
Edie Carney (she/her)

Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

Two Towne Square | Suite 700 | Southfield, MI 48076

www.atwell.com

Local Solutions | National Presence





Outlook

Re: Proposed Riverbend Wind Project Follow-Up

From Edie Carney <ecarney@atwell.com>

Date Tue 12/9/2025 1:05 PM

To elkfirerescue@gmail.com <elkfirerescue@gmail.com>

Cc Benjamin Sanford <bsanford@atwell.com>

 1 attachment (437 KB)

Elk Township Fire_Rescue.pdf;

See attached initial letter.

Thanks,

Edie Carney (she/her)
Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

From: Edie Carney <ecarney@atwell.com>

Sent: Tuesday, December 9, 2025 12:52 PM

To: elkfirerescue@gmail.com <elkfirerescue@gmail.com>

Cc: Benjamin Sanford <bsanford@atwell.com>

Subject: Proposed Riverbend Wind Project Follow-Up

Hello Fire Chief Ernest Kilgus,

This email is to follow up on the Emergency Response Plan and Fire Response Plan prepared for the Riverbend Wind Energy Facility (the Project) proposed by MI Energy Developments, LLC (the applicant), a subsidiary of REV Renewables. The Fire Response Plan and Emergency Response Plan were sent to your department via U.S. certified mail on February 27, 2025 in accordance with the new Michigan Public Service Commission (MPSC) guidelines. The plans, as well as a copy of the initial letter are attached for reference. To date, a response has not been received, and the applicant would like to again extend an invitation to meet and discuss the proposed plans and address any questions, concerns or proposed edits you may have.

If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Regards,

Edie Carney (she/her)

Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

Two Towne Square | Suite 700 | Southfield, MI 48076

www.atwell.com

Local Solutions | National Presence





Re: Proposed Riverbend Wind Project Follow-Up

From Edie Carney <ecarney@atwell.com>

Date Tue 12/9/2025 1:06 PM

To rmajorvillageofpeck@gmail.com <rmajorvillageofpeck@gmail.com>

Cc Benjamin Sanford <bsanford@atwell.com>

 1 attachment (437 KB)

Peck Police Department.pdf;

See attached initial letter.

Thanks,

Edie Carney (she/her)
Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

From: Edie Carney <ecarney@atwell.com>

Sent: Tuesday, December 9, 2025 12:55 PM

To: rmajorvillageofpeck@gmail.com <rmajorvillageofpeck@gmail.com>

Cc: Benjamin Sanford <bsanford@atwell.com>

Subject: Proposed Riverbend Wind Project Follow-Up

Hello Police Chief Rob Major,

This email is to follow up on the Emergency Response Plan and Fire Response Plan prepared for the Riverbend Wind Energy Facility (the Project) proposed by MI Energy Developments, LLC (the applicant), a subsidiary of REV Renewables. The Fire Response Plan and Emergency Response Plan were sent to your department via U.S. certified mail on February 27, 2025 in accordance with the new Michigan Public Service Commission (MPSC) guidelines. The plans, as well as a copy of the initial letter are attached for reference. To date, a response has not been received, and the applicant would like to again extend an invitation to meet and discuss the proposed plans and address any questions, concerns or proposed edits you may have.

If you wish to have a meeting, please respond to this correspondence by contacting Ben Sanford with Atwell via email at bsanford@atwell.com or by phone (517)-648-7082 to schedule a time to meet.

Regards,

Edie Carney (she/her)
Environmental Consultant

ATWELL, LLC

248.447.2000 Office

810.772.0349 Mobile

Two Towne Square | Suite 700 | Southfield, MI 48076

www.atwell.com

Local Solutions | National Presence



Benjamin Sanford

From: Benjamin Sanford
Sent: Wednesday, December 17, 2025 12:40 PM
To: 'Rob Major'
Subject: RE: Riverbend Project

Good afternoon,

Thanks for the follow up email. Understanding that the Village of Peck is outside of the project area we still wanted to share our response plans with surrounding local first responders. If you do have any concerns or questions, I'm happy to answer or could connect you with someone on the development team. We are in the process of also coordinating with the Sanilac County Sheriff's Office along with several other departments in the area.

Also, I've noted your correction to our emergency response routes mapping and we will update the figure to depict the Village of Peck Police Department.

Regards,

Benjamin Sanford
Project Manager
ATWELL, LLC
248.447.2000 Office
517.648.7082 Mobile

From: Rob Major <rmajor@villageofpeck.com>
Sent: Thursday, December 11, 2025 10:31 AM
To: Benjamin Sanford <bsanford@atwell.com>
Subject: Riverbend Project

Good morning,

I briefly went over the project plans/emergency response plans that were sent out. It appears that the project area is well outside of the Village Limits where we have no jurisdiction. Have you reached out to the Sheriffs Office with he response plan?

Also going over the route plans, Elk Twp. Does not have a Police Department.

Rob Major
Chief of Police
Village of Peck
810-414-1911 (Work Cell)
810-378-5131 (Office)



***CONFIDENTIALITY NOTICE: ***

*Confidentiality Notice: Information contained in this email and/or attachments to it may be confidential and legally privileged. This information is intended only for the use of the individual to whom this email is addressed. If you are not that person, you are hereby notified that any use, disclosure, printing, or distribution of any of the information contained herein is strictly PROHIBITED. If you have received this email in error, please notify the sender and delete this email and any attachments immediately. *

External Email: Do not click any links or open any attachments unless you trust the sender and know the content is safe.